
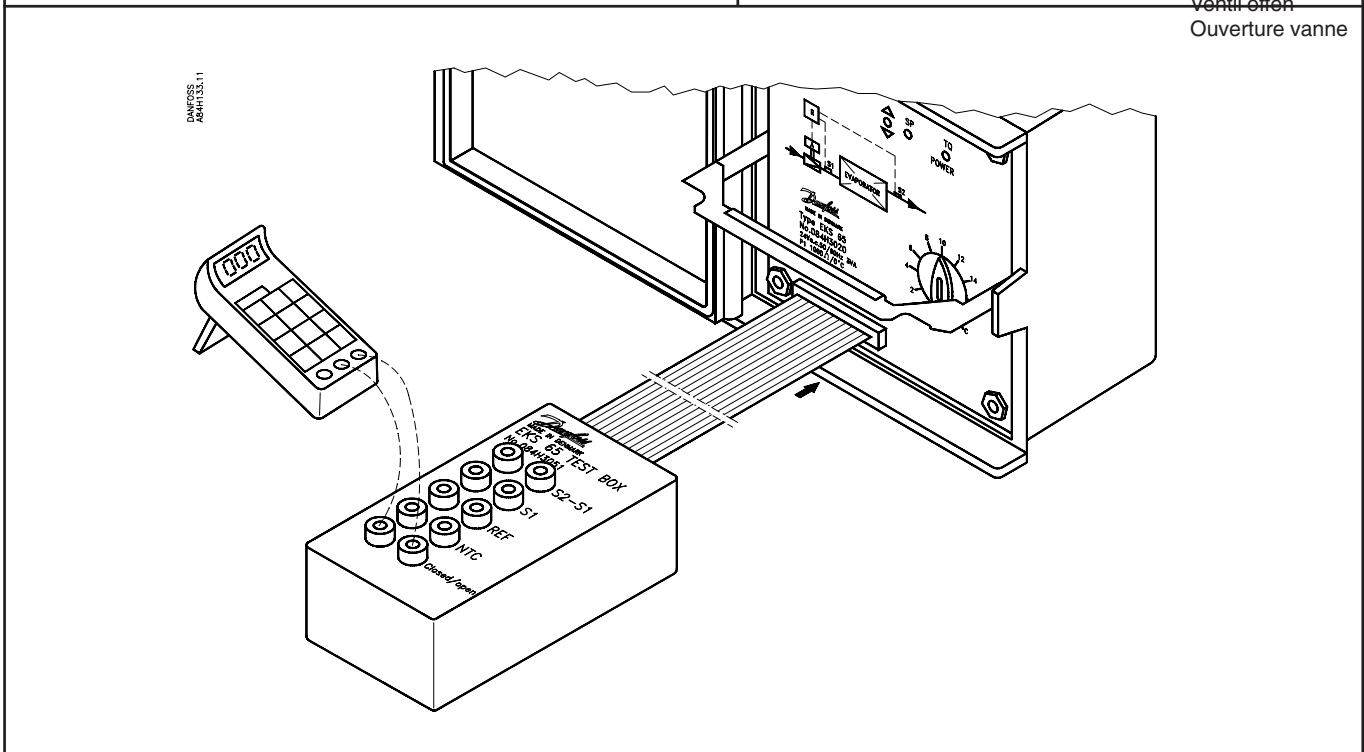


INSTRUCTIONS

EKS 65 Testbox

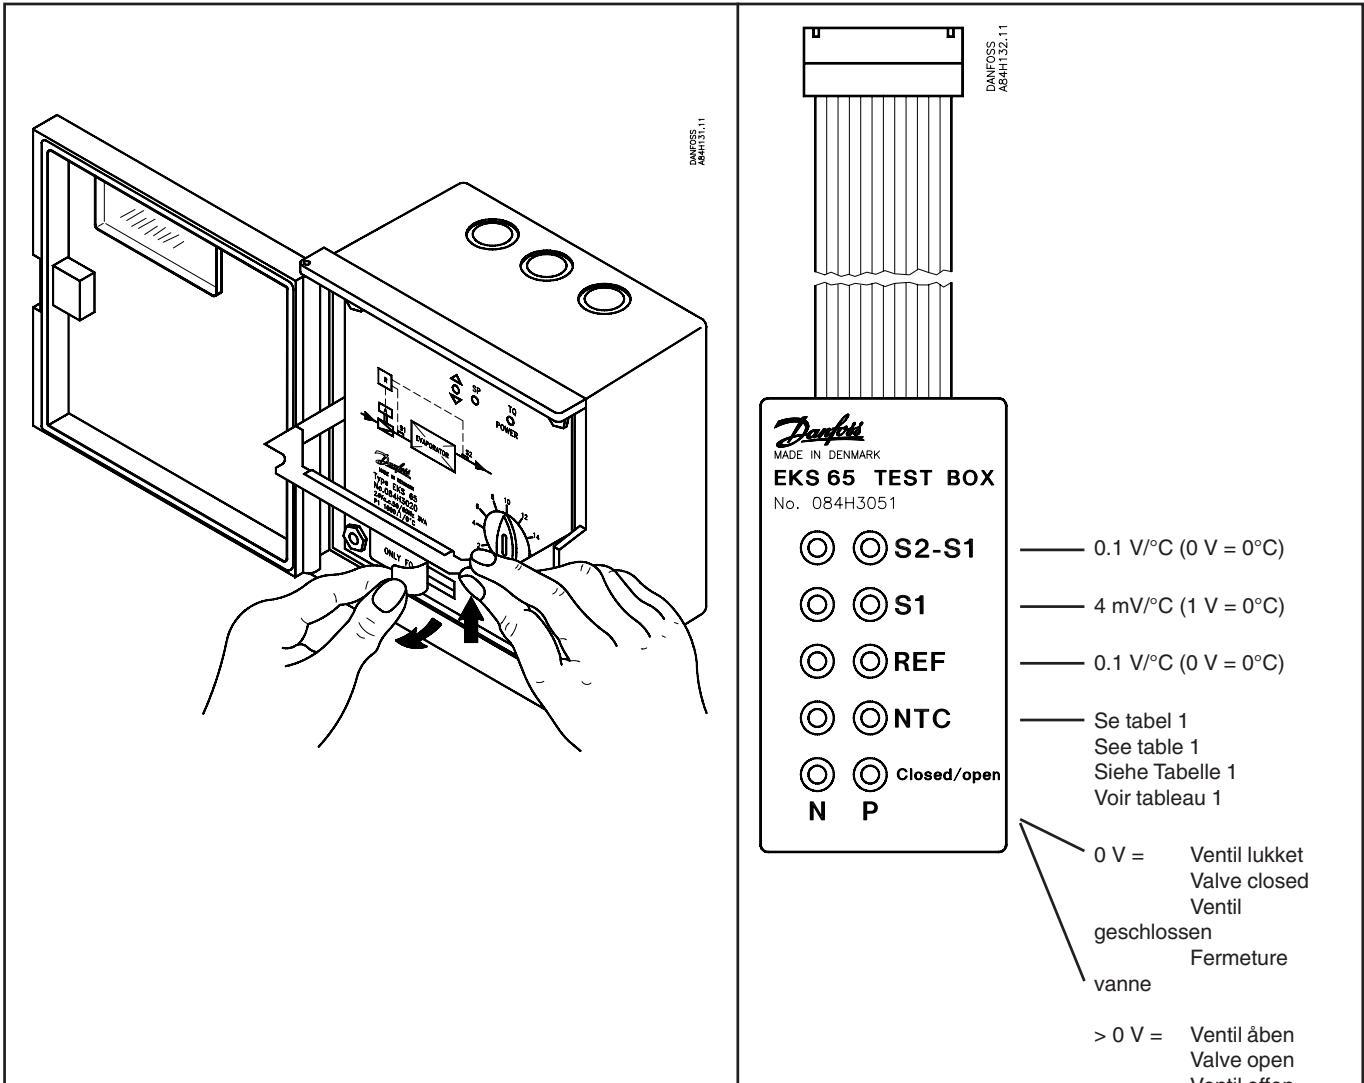

Tabel 1
Table 1
Tabelle 1
Tableau 1

NTC værdier
 NTC values
 NTC Werte
 NTC valeurs

Aktuator Actuator Stellantrieb Actuateur	NTC	Aktuator Actuator Stellantrieb Actuateur	NTC
Temp. (°C)	Volt	Temp. (°C)	Volt
20	3.86	91	1.87
25	3.77	92	1.84
30	3.66	93	1.81
35	3.55	94	1.78
40	3.43	95	1.75
45	3.29	96	1.72
50	3.15	97	1.70
55	3.00	98	1.67
60	2.84	99	1.64
61	2.81	100	1.61
62	2.78	101	1.59
63	2.75	102	1.56
64	2.72	103	1.53
65	2.68	104	1.51
66	2.65	105	1.48
67	2.62	106	1.46
68	2.59	107	1.43
69	2.56	108	1.41
70	2.52	109	1.39
71	2.49	110	1.36
72	2.46	111	1.34
73	2.43	112	1.32
74	2.39	113	1.29
75	2.36	114	1.27
76	2.33	115	1.25
77	2.30	116	1.23
78	2.27	117	1.21
79	2.23	118	1.18
80	2.20	119	1.16
81	2.17	120	1.14
82	2.14	125	1.05
83	2.11	130	0.96
84	2.08	135	0.87
85	2.05	140	0.80
86	2.02	145	0.73
87	1.99	150	0.67
88	1.96		
89	1.93		
90	1.90		

Tabel 2
Table 2
Tabelle 2
Tableau 2

Pt 1000 ohm

°C	ohm	°C	ohm
0	1000,0	0	1000,0
1	1003,9	-1	996,1
2	1007,8	-2	992,2
3	1011,7	-3	988,3
4	1015,6	-4	984,4
5	1019,5	-5	980,4
6	1023,4	-6	976,5
7	1027,3	-7	972,6
8	1031,2	-8	968,7
9	1035,1	-9	964,8
10	1039,0	-10	960,9
11	1042,9	-11	956,9
12	1046,8	-12	953,0
13	1050,7	-13	949,1
14	1054,6	-14	945,2
15	1058,5	-15	941,2
16	1062,4	-16	937,3
17	1066,3	-17	933,4
18	1070,2	-18	929,5
19	1074,0	-19	925,5
20	1077,9	-20	921,6
21	1081,8	-21	917,7
22	1085,7	-22	913,7
23	1089,6	-23	909,8
24	1093,5	-24	905,9
25	1097,3	-25	901,9
26	1101,2	-26	898,0
27	1105,1	-27	894,0
28	1109,0	-28	890,1
29	1112,8	-29	886,2
30	1116,7	-30	882,2
35	1136,1	-35	862,5
40	1155,4	-40	842,8
45	1174,7	-45	822,9
50	1193,9	-50	803,1