

009R9508




Temperature range:
-40°C → 150°C
(-40°F → 300°F)




PS/MWP = 45 bar (650 psig)


009R9508

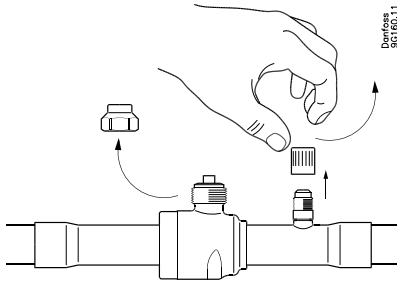

Remove cap and access cap (if present)




Open




Closed




Change stem direction to open position

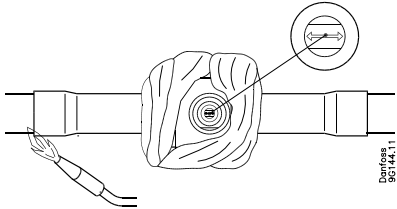


OPEN position

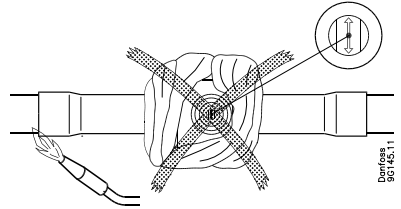


CLOSED position

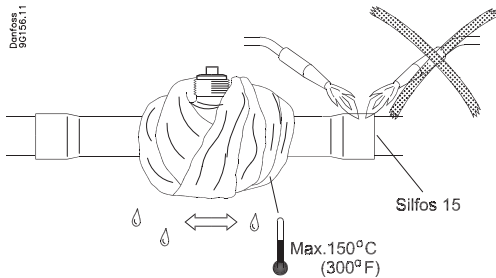


Install Schraeder valve
and cap (if present)

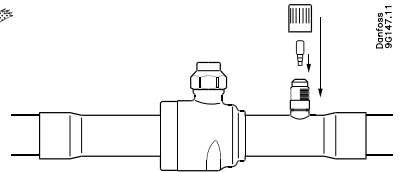


Open / close valves

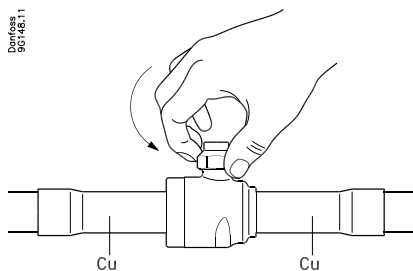


Remove cap

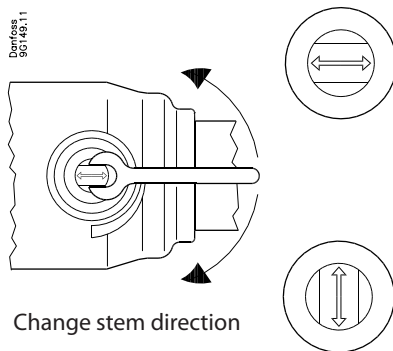


Change stem direction

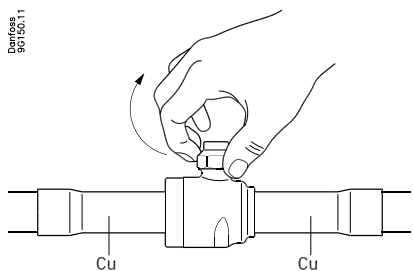

Hand tighten cap

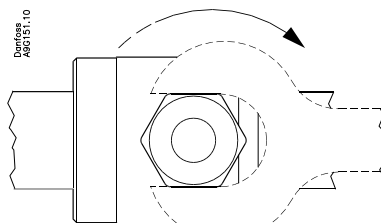

Tighten

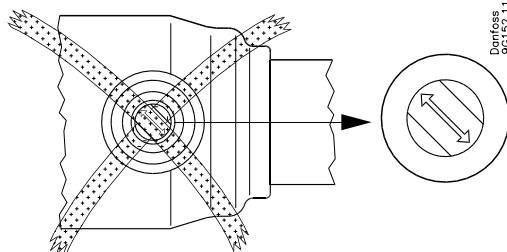

**Ball valve must always be in either
FULLY OPEN or
FULLY CLOSED position**