




INSTRUCTIONS


DCR



023R9504

HFC, HCFC, CFC refrigerants
PB/MWP = 35 bar/500 psig (DCR 0485 - 14417)
PB/MWP = 28 bar/400 psig (DCR 19211 - 19217)

Note! Max. working pressure (PB/MWP) shall not be less than the pressure outlined in sect. 8.2 of ANSI / ASHRAE 15 for the refrigerant used in the system. After charging, the system shall be marked with the refrigerant and oil used.


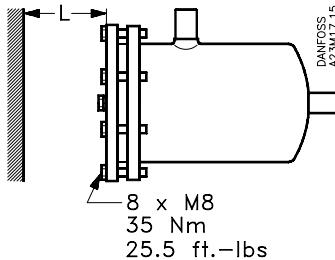


Type	L	
	mm	in.
DCR 048	170	7
DCR 096	310	12
DCR 144	310	12
DCR 192	310	12

023R9504

Installation

Liquide line
 $t_l > 0^\circ\text{C}$ (32°F)

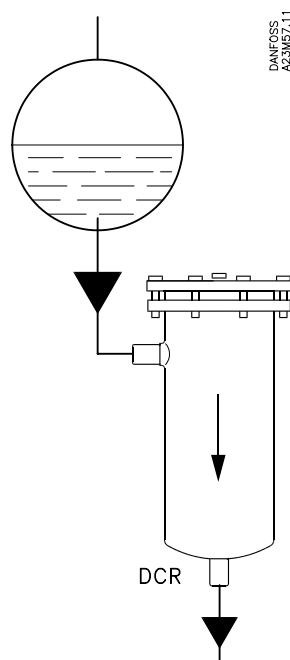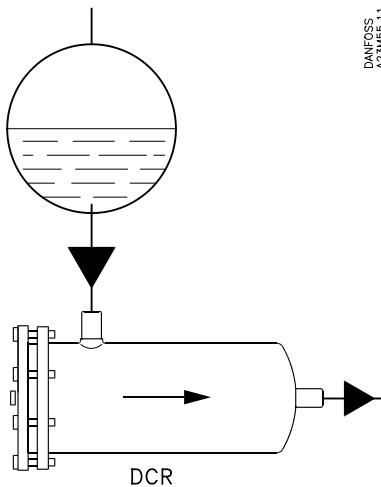

Installation

Suction line
 $t_s > 0^\circ\text{C}$ (32°F)

