





Temperature range:
-40°C → 150°C
(-40°F → 300°F)



PS/MWP = 45 bar (650 psig)

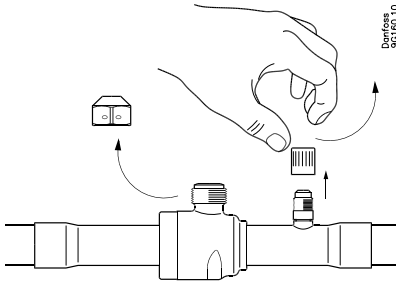

Remove cap and access cap (if present)

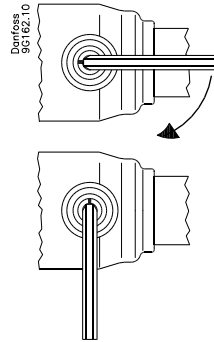


Open




Closed





Change stem direction to open position

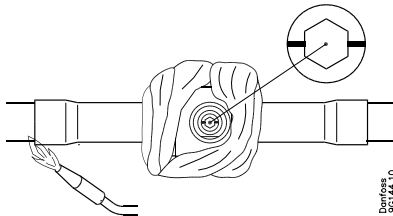

OPEN position

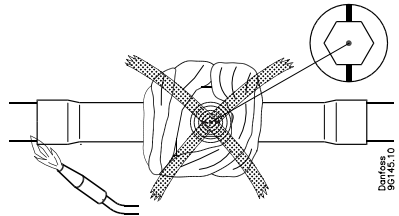


CLOSED position

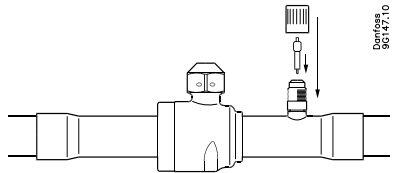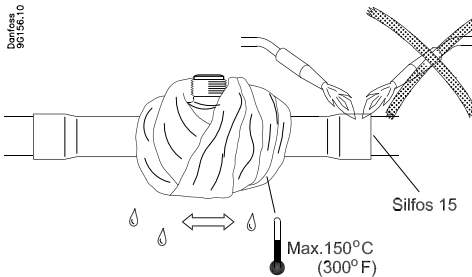


Install Schraeder valve
and cap (if present)


Open / close valves

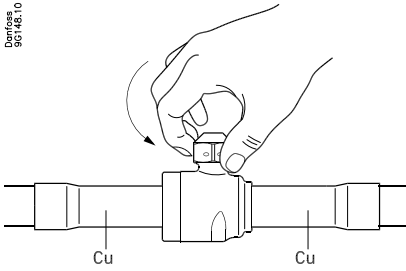


Remove cap

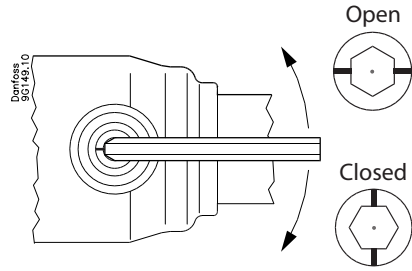


Change stem direction

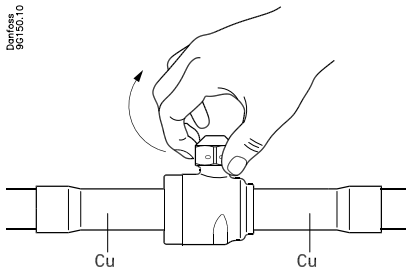

Hand tighten cap

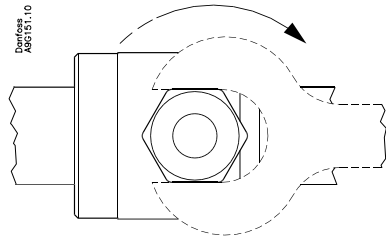

Tighten

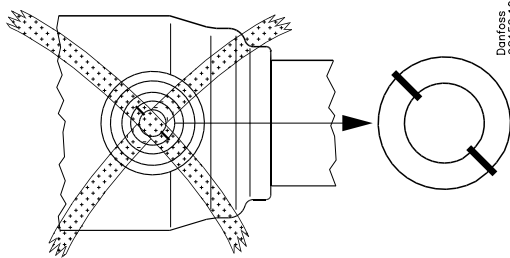

**Ball valve must always be in either
FULLY OPEN or
FULLY CLOSED position**