

### Installation

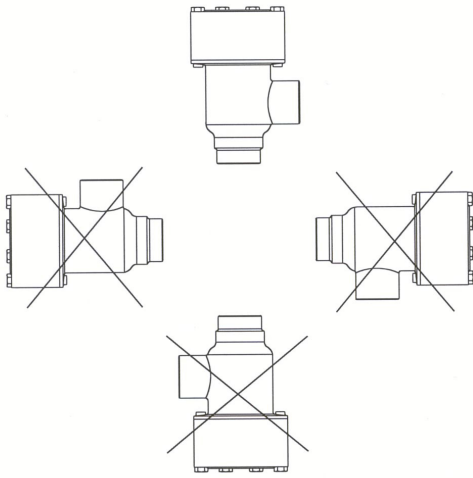


Fig. 1

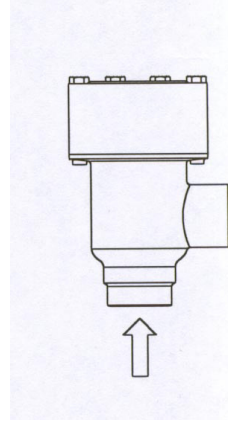


Fig. 2

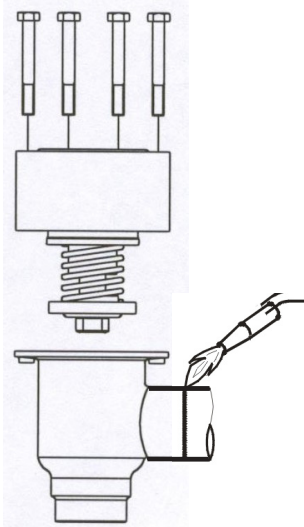


Fig. 3

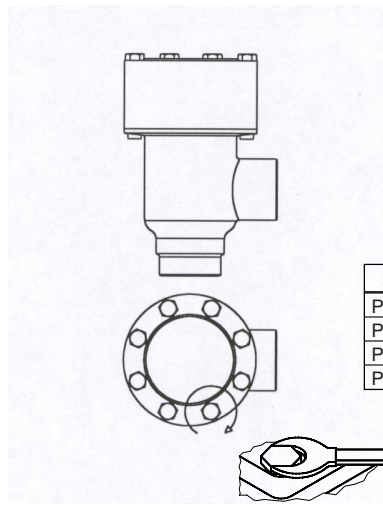


Fig. 4

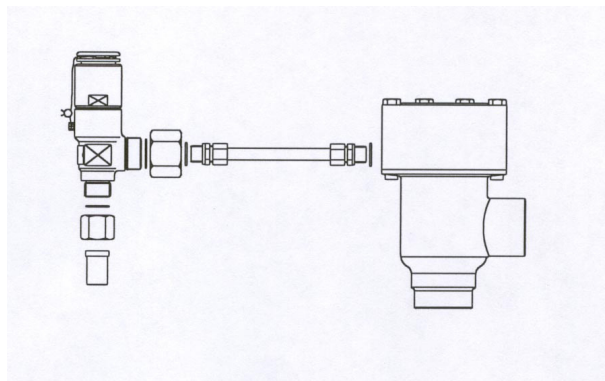


Fig. 5

## Installation

### Refrigerants

Applicable to all common non-flammable refrigerants, including R717 and non-corrosive gases/liquids dependent on sealing material compatibility. Flammable hydrocarbons are not recommended. The valve is only recommended for use in closed circuits. For further information please contact Danfoss.

### Temperature range

POV:  $-50/+150^{\circ}\text{C}$  ( $-58/+302^{\circ}\text{F}$ )

### Pressure range

The valves are designed for a max. working pressure of 25 bar g (363 psi g).

### Installation

The POV pilot operated safety valve is used in conjunction with the BSV back pressure independent safety valve and is specifically designed for protecting compressors against excessive pressure (fig. 5).

See technical leaflet for further installation instructions.

The valve should be installed with the spring housing upwards (fig. 1). By mounting of the valve it is important to avoid the influence of thermic and dynamic stress (vibrations).

The valve is designed to withstand a high internal pressure. However, the piping system should be designed to avoid liquid traps and reduce the risk of hydraulic pressure caused by thermal expansion. It must be ensured that the valve is protected from pressure transients like "liquid hammer" in the system.

### Recommended flow direction

The valve should be installed with the flow towards the valve cone as indicated by the arrow on fig. 2.

Flow in the opposite direction is not acceptable.

### Welding

The top should be removed before welding (fig. 3) to prevent damage to the O-rings between the valve body and top, as well as the teflon gasket in the valve seat. Only materials and welding methods compatible with the valve housing material must be welded to the valve housing. The valve should be cleaned internally to remove welding debris on completion of welding and before the valve is reassembled.

Avoid welding debris and dirt in the threads of the housing and the top.

Removing the top can be omitted provided that:

The temperature in the area between the valve body and top as well as in the area between the seat and the teflon cone

during welding does not exceed  $+150^{\circ}\text{C}/+302^{\circ}\text{F}$ . This temperature depends on the welding method as well as on any cooling of the valve body during the welding itself (cooling can be ensured by, for example, wrapping a wet cloth around the valve body). Make sure that no dirt, welding debris etc. get into the valve during the welding procedure.

Be careful not to damage the teflon cone ring.

The valve housing must be free from stresses (external loads) after installation.

### Assembly

Remove welding debris and any dirt from pipes and valve body before assembly.

### Tightening

Tighten the top with a torque wrench to the values indicated in the table (fig. 4).

### Colours and identification

Precise identification of the valve is made via the ID label on the top, as well as by the stamping on the valve body. The external surface of the valve housing must be prevented against corrosion with a suitable protective coating after installation and assembly.

Protection of the ID label when painting the valve is recommended.

In cases of doubt, please contact Danfoss.

Danfoss accepts no responsibility for errors and omissions. Danfoss Industrial Refrigeration reserves the right to make changes to products and specifications without prior notice.



**DECLARATION OF CONFORMITY**  
The Pressure Equipment Directive 97/23/EC



**Name and Address of Manufacturer within the European Community**

Danfoss Industrial Refrigeration A/S  
Stormosevej 10  
PO Box 60  
DK-8361 Hasselager  
Denmark

**Description of Pressure Equipment**

Pilot operated internal safety valve

**Type POV 40, 50, 1050, and 80**

Nominal bore	<b>DN40-80 mm. (1½-3 in.)</b>	
Classified for	<b>Fluid Group I</b> (all refrigerants (toxic, nontoxic, flammable and nonflammable)). For further details / restrictions - see Installation Instruction.	
Temperature range	POV 40, 50, 1050, and 80	-50°C/+150°C (-58°F/+302°F)
Restrictions	POV 40, 50, 1050, and 80	Only for use in conjunction with BSV 8
Maximum allowable working pressure	POV 40, 50, 1050, and 80	<b>25 bar (363 psi) -50°C/+150°C (-58°F/+302°F)</b>

**Conformity and Assessment Procedure Followed**

Category	<b>I</b>		<b>II</b>
Module	<b>A</b>		<b>D1</b>
Certificate ID			<i>D1: 07 202 0511 Z 0009/1/H-0002</i>
Nominal bore	Standard applications	DN40 mm. (1½ in.)	DN50-80 mm. (2-3 in.)

**Name and Address of the Notified Body which carried out the Inspection**

TÜV-Nord e.V.  
Grosse Bahnstrasse 31  
22525 Hamburg, Germany

**Name and Address of the Notified Body monitoring the Manufacturer's Quality Assurance System**

TÜV-Nord e.V.  
Grosse Bahnstrasse 31  
22525 Hamburg, Germany



**References of Harmonised Standards used**

**References of other Technical Standards and Specifications used**

prEN 12284                      prEN 13136  
AD-Merkblätter                DIN 3158

**Authorised Person for the Manufacturer within the European Community**

**Name:** Morten Steen Hansen                      **Title:** Production Manager

**Signature:** Morten Steen Hansen                      **Date:** 26/05/2003